



PATRIOT HOME INSPECTIONS

8129659676

matt@patriothome.us

<http://www.patriothome.us>



RESIDENTIAL REPORT

1234 Main St.
Newburgh IN 47630

Buyer Name
11/28/2018 9:00AM



Inspector
Matt Broerman
InterNACHI Certified Home Inspector
812-965-9676
mbroerman13@gmail.com



Agent
Agent Name
555-555-5555
agent@spectora.com

Table of Contents

Table of Contents	2
SUMMARY	3
1: INSPECTION DETAILS	4
2: ROOF	5
3: EXTERIOR	8
4: BASEMENT, FOUNDATION, CRAWLSPACE & STRUCTURE	10
5: HEATING	11
6: COOLING	12
7: PLUMBING	13
8: ELECTRICAL	16
9: FIREPLACE	18
10: ATTIC, INSULATION & VENTILATION	19
11: DOORS, WINDOWS & INTERIOR	20
STANDARDS OF PRACTICE	23

SUMMARY



MAINTENANCE ITEM



RECOMMENDATION



SAFETY HAZARD

- ⊖ 2.1.1 Roof - Coverings: Damaged (General)
- ⊖ 2.2.1 Roof - Roof Drainage Systems: Debris
- ⊖ 2.2.2 Roof - Roof Drainage Systems: Downspouts Drain Near House
- ⊖ 2.2.3 Roof - Roof Drainage Systems: Downspouts Missing
- ⊖ 2.2.4 Roof - Roof Drainage Systems: Gutter Damaged
- ⊖ 2.3.1 Roof - Flashings: Corroded - Severe
- ⊖ 3.3.1 Exterior - Exterior Windows: Window Showing Deterioration
- ⊖ 3.3.2 Exterior - Exterior Windows: Paint/Refinish Needed
- ⊖ 3.4.1 Exterior - Walkways, Patios & Driveways: Driveway Trip Hazard
- ⊖ 3.6.1 Exterior - Eaves, Soffits & Fascia: Eaves - Damaged
- 🔧 7.3.1 Plumbing - Water Supply, Distribution Systems & Fixtures: Main Water Supply Pipe Corroded
- ⊖ 7.3.2 Plumbing - Water Supply, Distribution Systems & Fixtures: Drain Stopper
- ⊖ 7.4.1 Plumbing - Hot Water Systems, Controls, Flues & Vents: No Drip Pan
- ⊖ 7.4.2 Plumbing - Hot Water Systems, Controls, Flues & Vents: Vent Connection Installed Improperly
- ⚠️ 8.4.1 Electrical - Lighting Fixtures, Switches & Receptacles: Reverse Polarity
- ⚠️ 8.4.2 Electrical - Lighting Fixtures, Switches & Receptacles: Ungrounded Receptacle
- 🔧 10.1.1 Attic, Insulation & Ventilation - Attic Insulation: Improper Installation
- ⚠️ 10.3.1 Attic, Insulation & Ventilation - Ventilation: Dryer Vent
- ⊖ 11.1.1 Doors, Windows & Interior - Doors: Door Doesn't Latch
- ⊖ 11.1.2 Doors, Windows & Interior - Doors: Door Sticks
- ⊖ 11.2.1 Doors, Windows & Interior - Windows: Damaged
- ⊖ 11.2.2 Doors, Windows & Interior - Windows: Window Inoperable

1: INSPECTION DETAILS

Information

In Attendance

Client

Occupancy

Vacant

Style

Ranch

Temperature (approximate)

30 Fahrenheit (F)

Type of Building

Single Family

Weather Conditions

Cloudy

2: ROOF

		IN	NI	NP	D
2.1	Coverings	X			X
2.2	Roof Drainage Systems	X			X
2.3	Flashings	X			X
2.4	Skylights, Chimneys & Other Roof Penetrations	X			X

IN = Inspected NI = Not Inspected NP = Not Present D = Deficiencies

Information

Inspection Method

Ladder

Roof Type/Style

Gable

Coverings: Material

Asphalt

Roof Drainage Systems: Gutter Material

Aluminum

Flashings: Material

Aluminum, Asphalt

Deficiencies

2.1.1 Coverings

DAMAGED (GENERAL)

Recommendation

Roof coverings showed moderate damage. Recommend a qualified roofing professional evaluate and repair.

2.2.1 Roof Drainage Systems

DEBRIS

Recommendation

Debris has accumulated in the gutters. Recommend cleaning to facilitate water flow.

[Here is a DIY resource](#) for cleaning your gutters.

2.2.2 Roof Drainage Systems

DOWNSPOUTS DRAIN NEAR HOUSE

Recommendation

One or more downspouts drain too close to the home's foundation. This can result in excessive moisture in the soil at the foundation, which can lead to foundation/structural movement. Recommend a qualified contractor adjust downspout extensions to drain at least 6 feet from the foundation.

[Here is a helpful DIY link](#) and video on draining water flow away from your house.



2.2.3 Roof Drainage Systems

DOWNSPOUTS MISSING

 Recommendation

Home was missing downspouts in one or more areas. This can result in excessive moisture in the soil at the foundation, which can lead to foundation/structural movement. Recommend a qualified contractor install downspout extensions that drain at least 6 feet from the foundation.



2.2.4 Roof Drainage Systems

GUTTER DAMAGED

 Recommendation

Gutters were damaged. This can result in excessive moisture in the soil at the foundation, which can lead to foundation/structural movement. Recommend a qualified contractor evaluate and repair.



2.3.1 Flashings

CORRODED - SEVERE

 Recommendation

Roof flashing showed signs of severe corrosion, which can lead to moisture intrusion and/or mold. Recommend a qualified roofing contractor evaluate and repair.



3: EXTERIOR

		IN	NI	NP	D
3.1	Siding, Flashing & Trim	X			
3.2	Exterior Doors	X			
3.3	Exterior Windows	X			X
3.4	Walkways, Patios & Driveways	X			X
3.5	Decks, Balconies, Porches & Steps			X	
3.6	Eaves, Soffits & Fascia	X			X
3.7	Vegetation, Grading, Drainage & Retaining Walls	X			

IN = Inspected NI = Not Inspected NP = Not Present D = Deficiencies

Information

Inspection Method

Visual

Siding, Flashing & Trim: Siding Material

Aluminum

Siding, Flashing & Trim: Siding Style

Panels

Exterior Doors: Exterior Entry Door

Steel

Walkways, Patios & Driveways: Driveway Material

Concrete, Gravel

Deficiencies

3.3.1 Exterior Windows

 Recommendation

WINDOW SHOWING DETERIORATION

Window showing signs of deterioration. Recommend repair or replace

Recommendation

Contact a qualified window repair/installation contractor.



3.3.2 Exterior Windows

 Recommendation

PAINT/REFINISH NEEDED

Paint/Finish showing signs of wear. Recommend repair.

Recommendation

Contact a qualified window repair/installation contractor.



3.4.1 Walkways, Patios & Driveways

DRIVEWAY TRIP HAZARD

DRIVEWAY

Trip hazards observed, driveway near road has pot holes. Patch or repair recommended.



3.6.1 Eaves, Soffits & Fascia

EAVES - DAMAGED

One or more sections of the eaves are missing. Recommend qualified roofer replace & repair.



4: BASEMENT, FOUNDATION, CRAWLSPACE & STRUCTURE

		IN	NI	NP	D
4.1	Foundation	X			
4.2	Basements & Crawlspace			X	
4.3	Floor Structure			X	
4.4	Wall Structure	X			
4.5	Ceiling Structure			X	

IN = Inspected NI = Not Inspected NP = Not Present D = Deficiencies

Information

Inspection Method
Visual

Foundation: Material
Slab on Grade

5: HEATING

		IN	NI	NP	D
5.1	Equipment	X			
5.2	Normal Operating Controls	X			
5.3	Distribution Systems	X			
5.4	Presence of Installed Heat Source in Each Room	X			

IN = Inspected NI = Not Inspected NP = Not Present D = Deficiencies

Information

Gas Shut Off - Furnace

Utility Closet

Located within reach.

Equipment: Brand

Payne

Equipment: Energy Source

Gas

Equipment: Heat Type

Forced Air

Equipment: Furnace

Utility Closet

Normal Operating Controls: Thermostat

Located in hallway across from bathroom

Distribution Systems: Ductwork

Non-insulated

Distribution Systems: Duct

Located within slab, vents appear to be flowing.

AFUE Rating

90%+

AFUE (Annual fuel utilization efficiency) is a metric used to measure furnace efficiency in converting fuel to energy. A higher AFUE rating means greater energy efficiency. 90% or higher meets the Department of Energy's Energy Star program standard.

6: COOLING

		IN	NI	NP	D
6.1	Cooling Equipment			X	
6.2	Normal Operating Controls			X	
6.3	Distribution System			X	
6.4	Presence of Installed Cooling Source in Each Room			X	

IN = Inspected

NI = Not Inspected

NP = Not Present

D = Deficiencies

7: PLUMBING

		IN	NI	NP	D
7.1	Main Water Shut-off Device	X			
7.2	Drain, Waste, & Vent Systems	X			
7.3	Water Supply, Distribution Systems & Fixtures	X			X
7.4	Hot Water Systems, Controls, Flues & Vents	X			X
7.5	Fuel Storage & Distribution Systems	X			
7.6	Sump Pump			X	

IN = Inspected NI = Not Inspected NP = Not Present D = Deficiencies

Information

Filters

None

Water Source

Public

Gas Shut Off - Hot Water Heater

Located within reach.

Main Water Shut-off Device: Location


Utility Room

Main Water Shut-off Device: Water Main

Located in utility closet next to water heater, labeled with orange tag.

Drain, Waste, & Vent Systems: Drain Size

1 1/2"

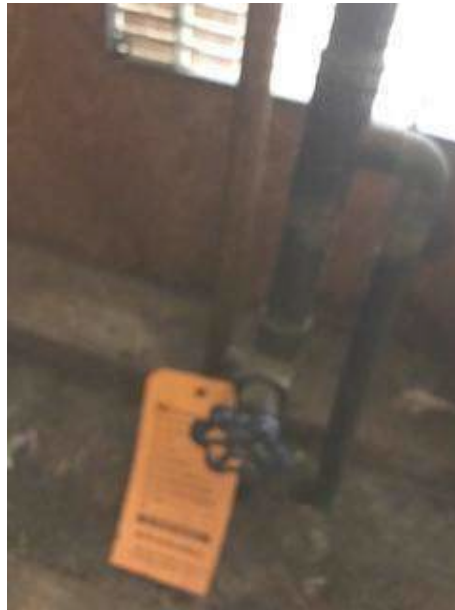

Drain, Waste, & Vent Systems: Material

PVC

Water Supply, Distribution Systems & Fixtures: Distribution Material

Copper, PVC

Water Supply, Distribution Systems & Fixtures: Water Supply Material

Copper, PVC

Hot Water Systems, Controls, Flues & Vents: Capacity

40 gallons

Hot Water Systems, Controls, Flues & Vents: Location

Utility Room

Hot Water Systems, Controls, Flues & Vents: Power Source/Type

Gas

Fuel Storage & Distribution

Systems: Main Gas Shut-off

Location

Gas Meter

Hot Water Systems, Controls, Flues & Vents: Manufacturer

AO Smith

I recommend flushing & servicing your water heater tank annually for optimal performance. Water temperature should be set to at least 120 degrees F to kill microbes and no higher than 130 degrees F to prevent scalding.

[Here is a nice maintenance guide from Lowe's to help.](#)

Deficiencies

7.3.1 Water Supply, Distribution Systems & Fixtures

 Maintenance Item

MAIN WATER SUPPLY PIPE CORRODED

BATHROOM

Bathroom sink supply showing corrosion. This can lead to shortened lifespan. Recommend monitor to prevent future issues.



7.3.2 Water Supply, Distribution Systems & Fixtures

 Recommendation

DRAIN STOPPER

BATHROOM

Bathroom sink drain stopper missing. Recommend replace & repair.

Recommendation

Contact a qualified plumbing contractor.



7.4.1 Hot Water Systems, Controls, Flues & Vents

 Recommendation

NO DRIP PAN

UTILITY CLOSET

No drip pan was present. Recommend installation by a qualified plumber.



7.4.2 Hot Water Systems, Controls, Flues & Vents

 Recommendation

VENT CONNECTION INSTALLED IMPROPERLY

UTILITY CLOSET

Vent connection taped, not screwed. Recommend repair & replace.

Recommendation

Contact a qualified professional.



8: ELECTRICAL

		IN	NI	NP	D
8.1	Service Entrance Conductors	X			
8.2	Main & Subpanels, Service & Grounding, Main Overcurrent Device	X			
8.3	Branch Wiring Circuits, Breakers & Fuses	X			
8.4	Lighting Fixtures, Switches & Receptacles	X			X
8.5	GFCI & AFCI	X			
8.6	Smoke Detectors	X			
8.7	Carbon Monoxide Detectors			X	

IN = Inspected NI = Not Inspected NP = Not Present D = Deficiencies

Information

Service Entrance Conductors:
Electrical Service Conductors
 Overhead

Main & Subpanels, Service & Grounding, Main Overcurrent Device: Main Panel Location
 Back

Main & Subpanels, Service & Grounding, Main Overcurrent Device: Panel Capacity
 100 AMP

Main & Subpanels, Service & Grounding, Main Overcurrent Device: Panel Manufacturer
 Square D

Main & Subpanels, Service & Grounding, Main Overcurrent Device: Panel Type
 Circuit Breaker

Main & Subpanels, Service & Grounding, Main Overcurrent Device: Sub Panel Location
 Middle Bedroom
 Bedroom

Branch Wiring Circuits, Breakers & Fuses: Branch Wire 15 and 20 AMP
 Copper

Branch Wiring Circuits, Breakers & Fuses: Wiring Method
 Romex

Smoke Detectors: Smoke Detector
 Hallway
 1 smoke detector found.

Deficiencies

8.4.1 Lighting Fixtures, Switches & Receptacles

REVERSE POLARITY

NW BEDROOM

One or more receptacles have been wired with reverse polarity. This can create a shock hazard. Recommend licensed electrician evaluate & repair.

Recommendation

Contact a qualified electrical contractor.



8.4.2 Lighting Fixtures, Switches & Receptacles

UNGROUND RECEPTACLE

LIVING ROOM, BEDROOM, KITCHEN

One or more receptacles are ungrounded. To eliminate safety hazards, all receptacles in kitchen, bathrooms, garage & exterior should be grounded.



Recommendation

Contact a qualified electrical contractor.



9: FIREPLACE

		IN	NI	NP	D
9.1	Vents, Flues & Chimneys		X		
9.2	Lintels		X		
9.3	Damper Doors		X		
9.4	Cleanout Doors & Frames		X		

IN = Inspected NI = Not Inspected NP = Not Present D = Deficiencies

Information

Type

Wood

Limitations

General

DOORS INACCESSIBLE

DINING ROOM

Fireplace doors screwed shut, looks to be out of service. Unable to inspect.



10: ATTIC, INSULATION & VENTILATION

		IN	NI	NP	D
10.1	Attic Insulation	X			X
10.2	Vapor Retarders (Crawlspace or Basement)			X	
10.3	Ventilation	X			X
10.4	Exhaust Systems	X			

IN = Inspected NI = Not Inspected NP = Not Present D = Deficiencies

Information

Dryer Power Source

110 Volt

Dryer Vent

Vinyl (Flex)

Flooring Insulation

None

Attic Insulation: Insulation Type

Batt, Cellulose

Attic Insulation: R-value

25

Ventilation: Ventilation Type

Gable Vents, Passive

Exhaust Systems: Exhaust Fans

None

Deficiencies

10.1.1 Attic Insulation



IMPROPER INSTALLATION

ATTIC

Excess attic insulation appears to be laying on attic floor uninstalled. Recommend remove excess insulation.



10.3.1 Ventilation

DRYER VENT

UTILITY ROOM/ATTIC



Dryer vent distance exceeds 25ft. Recommend replace with alternate vent route within approved distance

Recommendation

Contact a qualified professional.

11: DOORS, WINDOWS & INTERIOR

		IN	NI	NP	D
11.1	Doors	X			X
11.2	Windows	X			X
11.3	Floors	X			
11.4	Walls	X			
11.5	Ceilings	X			
11.6	Steps, Stairways & Railings	X			X
11.7	Countertops & Cabinets	X			

IN = Inspected NI = Not Inspected NP = Not Present D = Deficiencies

Information

Windows: Window Manufacturer **Windows: Window Type**

Unknown

Single-hung

Floors: Floor Coverings

Carpet, Tile

Walls: Wall Material

Drywall

Ceilings: Ceiling Material

Ceiling Tiles, Drywall

Countertops & Cabinets:

Cabinetry

Wood

Countertops & Cabinets:

Countertop Material

Laminate

Deficiencies

11.1.1 Doors

DOOR DOESN'T LATCH

BEDROOM



Recommendation

Each of the 3 bedroom doors don't latch properly. Recommend handyman repair latch and/or strike plate.



11.1.2 Doors

DOOR STICKS

BEDROOM

 Recommendation

Each of the 3 bedroom doors stick and are tough to open. Recommend repair.

Recommendation

Contact a qualified door repair/installation contractor.



11.2.1 Windows

DAMAGED

LIVING ROOM

 Recommendation

One or more windows appears to have general damage, but are operational. Recommend a window professional repair.



11.2.2 Windows

WINDOW INOPERABLE

SW BEDROOM

Window unable to open. Recommend repair.

Recommendation

Contact a qualified window repair/installation contractor.



STANDARDS OF PRACTICE

Roof

I. The inspector shall inspect from ground level or the eaves: A. the roof-covering materials; B. the gutters; C. the downspouts; D. the vents, flashing, skylights, chimney, and other roof penetrations; and E. the general structure of the roof from the readily accessible panels, doors or stairs. II. The inspector shall describe: A. the type of roof-covering materials. III. The inspector shall report as in need of correction: A. observed indications of active roof leaks. IV. The inspector is not required to: A. walk on any roof surface. B. predict the service life expectancy. C. inspect underground downspout diverter drainage pipes. D. remove snow, ice, debris or other conditions that prohibit the observation of the roof surfaces. E. move insulation. F. inspect antennae, satellite dishes, lightning arresters, de-icing equipment, or similar attachments. G. walk on any roof areas that appear, in the inspectors opinion, to be unsafe. H. walk on any roof areas if doing so might, in the inspector's opinion, cause damage. I. perform a water test. J. warrant or certify the roof. K. confirm proper fastening or installation of any roof-covering material.

Exterior

I. The inspector shall inspect: A. the exterior wall-covering materials, flashing and trim; B. all exterior doors; C. adjacent walkways and driveways; D. stairs, steps, stoops, stairways and ramps; E. porches, patios, decks, balconies and carports; F. railings, guards and handrails; G. the eaves, soffits and fascia; H. a representative number of windows; and I. vegetation, surface drainage, retaining walls and grading of the property, where they may adversely affect the structure due to moisture intrusion. II. The inspector shall describe: A. the type of exterior wall-covering materials. III. The inspector shall report as in need of correction: A. any improper spacing between intermediate balusters, spindles and rails. IV. The inspector is not required to: A. inspect or operate screens, storm windows, shutters, awnings, fences, outbuildings, or exterior accent lighting. B. inspect items that are not visible or readily accessible from the ground, including window and door flashing. C. inspect or identify geological, geotechnical, hydrological or soil conditions. D. inspect recreational facilities or playground equipment. E. inspect seawalls, breakwalls or docks. F. inspect erosion-control or earth-stabilization measures. G. inspect for safety-type glass. H. inspect underground utilities. I. inspect underground items. J. inspect wells or springs. K. inspect solar, wind or geothermal systems. L. inspect swimming pools or spas. M. inspect wastewater treatment systems, septic systems or cesspools. N. inspect irrigation or sprinkler systems. O. inspect drainfields or dry wells. P. determine the integrity of multiple-pane window glazing or thermal window seals.

Basement, Foundation, Crawlspace & Structure

I. The inspector shall inspect: A. the foundation; B. the basement; C. the crawlspace; and D. structural components. II. The inspector shall describe: A. the type of foundation; and B. the location of the access to the under-floor space. III. The inspector shall report as in need of correction: A. observed indications of wood in contact with or near soil; B. observed indications of active water penetration; C. observed indications of possible foundation movement, such as sheetrock cracks, brick cracks, out-of-square door frames, and unlevel floors; and D. any observed cutting, notching and boring of framing members that may, in the inspector's opinion, present a structural or safety concern. IV. The inspector is not required to: A. enter any crawlspace that is not readily accessible, or where entry could cause damage or pose a hazard to him/herself. B. move stored items or debris. C. operate sump pumps with inaccessible floats. D. identify the size, spacing, span or location or determine the adequacy of foundation bolting, bracing, joists, joist spans or support systems. E. provide any engineering or architectural service. F. report on the adequacy of any structural system or component.

Heating

I. The inspector shall inspect: A. the heating system, using normal operating controls. II. The inspector shall describe: A. the location of the thermostat for the heating system; B. the energy source; and C. the heating method. III. The inspector shall report as in need of correction: A. any heating system that did not operate; and B. if the heating system was deemed inaccessible. IV. The inspector is not required to: A. inspect or evaluate the interior of flues or chimneys, fire chambers, heat exchangers, combustion air systems, fresh-air intakes, humidifiers, dehumidifiers, electronic air filters, geothermal systems, or solar heating systems. B. inspect fuel tanks or underground or concealed fuel supply systems. C. determine the uniformity, temperature, flow, balance, distribution, size, capacity, BTU, or supply adequacy of the heating system. D. light or ignite pilot flames. E. activate heating, heat pump systems, or other heating systems when ambient temperatures or other circumstances are not conducive to safe operation or may damage the equipment. F. override electronic thermostats. G. evaluate fuel quality. H. verify thermostat calibration, heat anticipation, or automatic setbacks, timers, programs or clocks.

Cooling

I. The inspector shall inspect: A. the cooling system, using normal operating controls. II. The inspector shall describe: A. the location of the thermostat for the cooling system; and B. the cooling method. III. The inspector shall report as

in need of correction: A. any cooling system that did not operate; and B. if the cooling system was deemed inaccessible. IV. The inspector is not required to: A. determine the uniformity, temperature, flow, balance, distribution, size, capacity, BTU, or supply adequacy of the cooling system. B. inspect portable window units, through-wall units, or electronic air filters. C. operate equipment or systems if the exterior temperature is below 65 Fahrenheit, or when other circumstances are not conducive to safe operation or may damage the equipment. D. inspect or determine thermostat calibration, cooling anticipation, or automatic setbacks or clocks. E. examine electrical current, coolant fluids or gases, or coolant leakage.

Plumbing

I. The inspector shall inspect: A. the main water supply shut-off valve; B. the main fuel supply shut-off valve; C. the water heating equipment, including the energy source, venting connections, temperature/pressure-relief (TPR) valves, Watts 210 valves, and seismic bracing; D. interior water supply, including all fixtures and faucets, by running the water; E. all toilets for proper operation by flushing; F. all sinks, tubs and showers for functional drainage; G. the drain, waste and vent system; and H. drainage sump pumps with accessible floats. II. The inspector shall describe: A. whether the water supply is public or private based upon observed evidence; B. the location of the main water supply shut-off valve; C. the location of the main fuel supply shut-off valve; D. the location of any observed fuel-storage system; and E. the capacity of the water heating equipment, if labeled. III. The inspector shall report as in need of correction: A. deficiencies in the water supply by viewing the functional flow in two fixtures operated simultaneously; B. deficiencies in the installation of hot and cold water faucets; C. mechanical drain stops that were missing or did not operate if installed in sinks, lavatories and tubs; and D. toilets that were damaged, had loose connections to the floor, were leaking, or had tank components that did not operate. IV. The inspector is not required to: A. light or ignite pilot flames. B. measure the capacity, temperature, age, life expectancy or adequacy of the water heater. C. inspect the interior of flues or chimneys, combustion air systems, water softener or filtering systems, well pumps or tanks, safety or shut-off valves, floor drains, lawn sprinkler systems, or fire sprinkler systems. D. determine the exact flow rate, volume, pressure, temperature or adequacy of the water supply. E. determine the water quality, potability or reliability of the water supply or source. F. open sealed plumbing access panels. G. inspect clothes washing machines or their connections. H. operate any valve. I. test shower pans, tub and shower surrounds or enclosures for leakage or functional overflow protection. J. evaluate the compliance with conservation, energy or building standards, or the proper design or sizing of any water, waste or venting components, fixtures or piping. K. determine the effectiveness of anti-siphon, backflow prevention or drain-stop devices. L. determine whether there are sufficient cleanouts for effective cleaning of drains. M. evaluate fuel storage tanks or supply systems. N. inspect wastewater treatment systems. O. inspect water treatment systems or water filters. P. inspect water storage tanks, pressure pumps, or bladder tanks. Q. evaluate wait time to obtain hot water at fixtures, or perform testing of any kind to water heater elements. R. evaluate or determine the adequacy of combustion air. S. test, operate, open or close: safety controls, manual stop valves, temperature/pressure-relief valves, control valves, or check valves. T. examine ancillary or auxiliary systems or components, such as, but not limited to, those related to solar water heating and hot water circulation. U. determine the existence or condition of polybutylene plumbing. V. inspect or test for gas or fuel leaks, or indications thereof.

Electrical

I. The inspector shall inspect: A. the service drop; B. the overhead service conductors and attachment point; C. the service head, gooseneck and drip loops; D. the service mast, service conduit and raceway; E. the electric meter and base; F. service-entrance conductors; G. the main service disconnect; H. panelboards and over-current protection devices (circuit breakers and fuses); I. service grounding and bonding; J. a representative number of switches, lighting fixtures and receptacles, including receptacles observed and deemed to be arc-fault circuit interrupter (AFCI)-protected using the AFCI test button, where possible; K. all ground-fault circuit interrupter receptacles and circuit breakers observed and deemed to be GFCIs using a GFCI tester, where possible; and L. smoke and carbon-monoxide detectors. II. The inspector shall describe: A. the main service disconnect's amperage rating, if labeled; and B. the type of wiring observed. III. The inspector shall report as in need of correction: A. deficiencies in the integrity of the serviceentrance conductors insulation, drip loop, and vertical clearances from grade and roofs; B. any unused circuit-breaker panel opening that was not filled; C. the presence of solid conductor aluminum branch-circuit wiring, if readily visible; D. any tested receptacle in which power was not present, polarity was incorrect, the cover was not in place, the GFCI devices were not properly installed or did not operate properly, evidence of arcing or excessive heat, and where the receptacle was not grounded or was not secured to the wall; and E. the absence of smoke detectors. IV. The inspector is not required to: A. insert any tool, probe or device into the main panelboard, sub-panels, distribution panelboards, or electrical fixtures. B. operate electrical systems that are shut down. C. remove panelboard cabinet covers or dead fronts. D. operate or re-set over-current protection devices or overload devices. E. operate or test smoke or carbon-monoxide detectors or alarms. F. inspect, operate or test any security, fire or alarms systems or components, or other warning or signaling systems. G. measure or determine the amperage or voltage of the main service equipment, if not visibly labeled. H. inspect ancillary wiring or remote-control devices. I. activate any electrical systems or branch circuits that are not energized. J. inspect low-voltage systems, electrical de-icing tapes, swimming pool wiring, or any timecontrolled devices. K. verify the service ground. L. inspect private or emergency electrical supply sources, including, but not limited to: generators, windmills, photovoltaic solar collectors, or battery or electrical storage facility. M. inspect spark or lightning arrestors. N. inspect or test de-icing equipment. O. conduct voltage-drop calculations. P. determine the accuracy of labeling. Q. inspect exterior lighting.

Fireplace

I. The inspector shall inspect:

readily accessible and visible portions of the fireplaces and chimneys;

lintels above the fireplace openings;

damper doors by opening and closing them, if readily accessible and manually operable; and

cleanout doors and frames.

II. The inspector shall describe:

the type of fireplace.

III. The inspector shall report as in need of correction:

evidence of joint separation, damage or deterioration of the hearth, hearth extension or chambers;

manually operated dampers that did not open and close;

the lack of a smoke detector in the same room as the fireplace;

the lack of a carbon-monoxide detector in the same room as the fireplace; and

cleanouts not made of metal, pre-cast cement, or other non-combustible material.

IV. The inspector is not required to:

inspect the flue or vent system.

inspect the interior of chimneys or flues, fire doors or screens, seals or gaskets, or mantels.

determine the need for a chimney sweep.

operate gas fireplace inserts.

light pilot flames.

determine the appropriateness of any installation.

inspect automatic fuel-fed devices.

inspect combustion and/or make-up air devices.

inspect heat-distribution assists, whether gravity-controlled or fan-assisted.

ignite or extinguish fires.

determine the adequacy of drafts or draft characteristics.

move fireplace inserts, stoves or firebox contents.

perform a smoke test.

dismantle or remove any component.

perform a National Fire Protection Association (NFPA)-style inspection.

perform a Phase I fireplace and chimney inspection.

Attic, Insulation & Ventilation

I. The inspector shall inspect: A. insulation in unfinished spaces, including attics, crawlspaces and foundation areas; B. ventilation of unfinished spaces, including attics, crawlspaces and foundation areas; and C. mechanical exhaust systems in the kitchen, bathrooms and laundry area. II. The inspector shall describe: A. the type of insulation observed; and B. the approximate average depth of insulation observed at the unfinished attic floor area or roof structure. III. The inspector shall report as in need of correction: A. the general absence of insulation or ventilation in unfinished spaces. IV. The inspector is not required to: A. enter the attic or any unfinished spaces that are not readily accessible, or where entry could cause damage or, in the inspector's opinion, pose a safety hazard. B. move, touch or disturb insulation. C. move, touch or disturb vapor retarders. D. break or otherwise damage the surface finish or weather seal on or around access panels or covers. E. identify the composition or R-value of insulation material. F. activate thermostatically operated fans. G. determine the types of materials used in insulation or wrapping of pipes, ducts, jackets, boilers or wiring. H. determine the adequacy of ventilation.

Doors, Windows & Interior

I. The inspector shall inspect: A. a representative number of doors and windows by opening and closing them; B. floors, walls and ceilings; C. stairs, steps, landings, stairways and ramps; D. railings, guards and handrails; and E. garage vehicle doors and the operation of garage vehicle door openers, using normal operating controls. II. The inspector shall describe: A. a garage vehicle door as manually-operated or installed with a garage door opener. III. The inspector shall report as in need of correction: A. improper spacing between intermediate balusters, spindles and rails for steps, stairways, guards and railings; B. photo-electric safety sensors that did not operate properly; and C. any window that was obviously fogged or displayed other evidence of broken seals. IV. The inspector is not required to: A. inspect paint, wallpaper, window treatments or finish treatments. B. inspect floor coverings or carpeting. C. inspect central vacuum systems. D. inspect for safety glazing. E. inspect security systems or components. F. evaluate the fastening of islands, countertops, cabinets, sink tops or fixtures. G. move furniture, stored items, or any coverings, such as carpets or rugs, in order to inspect the concealed floor structure. H. move suspended-ceiling tiles. I. inspect or move any household appliances. J. inspect or operate equipment housed in the garage, except as otherwise noted. K. verify or certify the proper operation of any pressure-activated auto-reverse or related safety feature of a garage door. L. operate or evaluate any security bar release and opening mechanisms, whether interior or exterior, including their compliance with local, state or federal standards. M. operate any system, appliance or component that requires the use of special keys, codes, combinations or devices. N. operate or evaluate self-cleaning oven cycles, tilt guards/latches, or signal lights. O. inspect microwave ovens or test leakage from microwave ovens. P. operate or examine any sauna, steamgenerating equipment, kiln, toaster, ice maker, coffee maker, can opener, bread warmer, blender, instant hot-water dispenser, or other small, ancillary appliances or devices. Q. inspect elevators. R. inspect remote controls. S. inspect appliances. T. inspect items not permanently installed. U. discover firewall compromises. V. inspect pools, spas or fountains. W. determine the adequacy of whirlpool or spa jets, water force, or bubble effects. X. determine the structural integrity or leakage of pools or spas.